
Drg No. WD0292

DO NOT SCALE

THIRD ANGLE

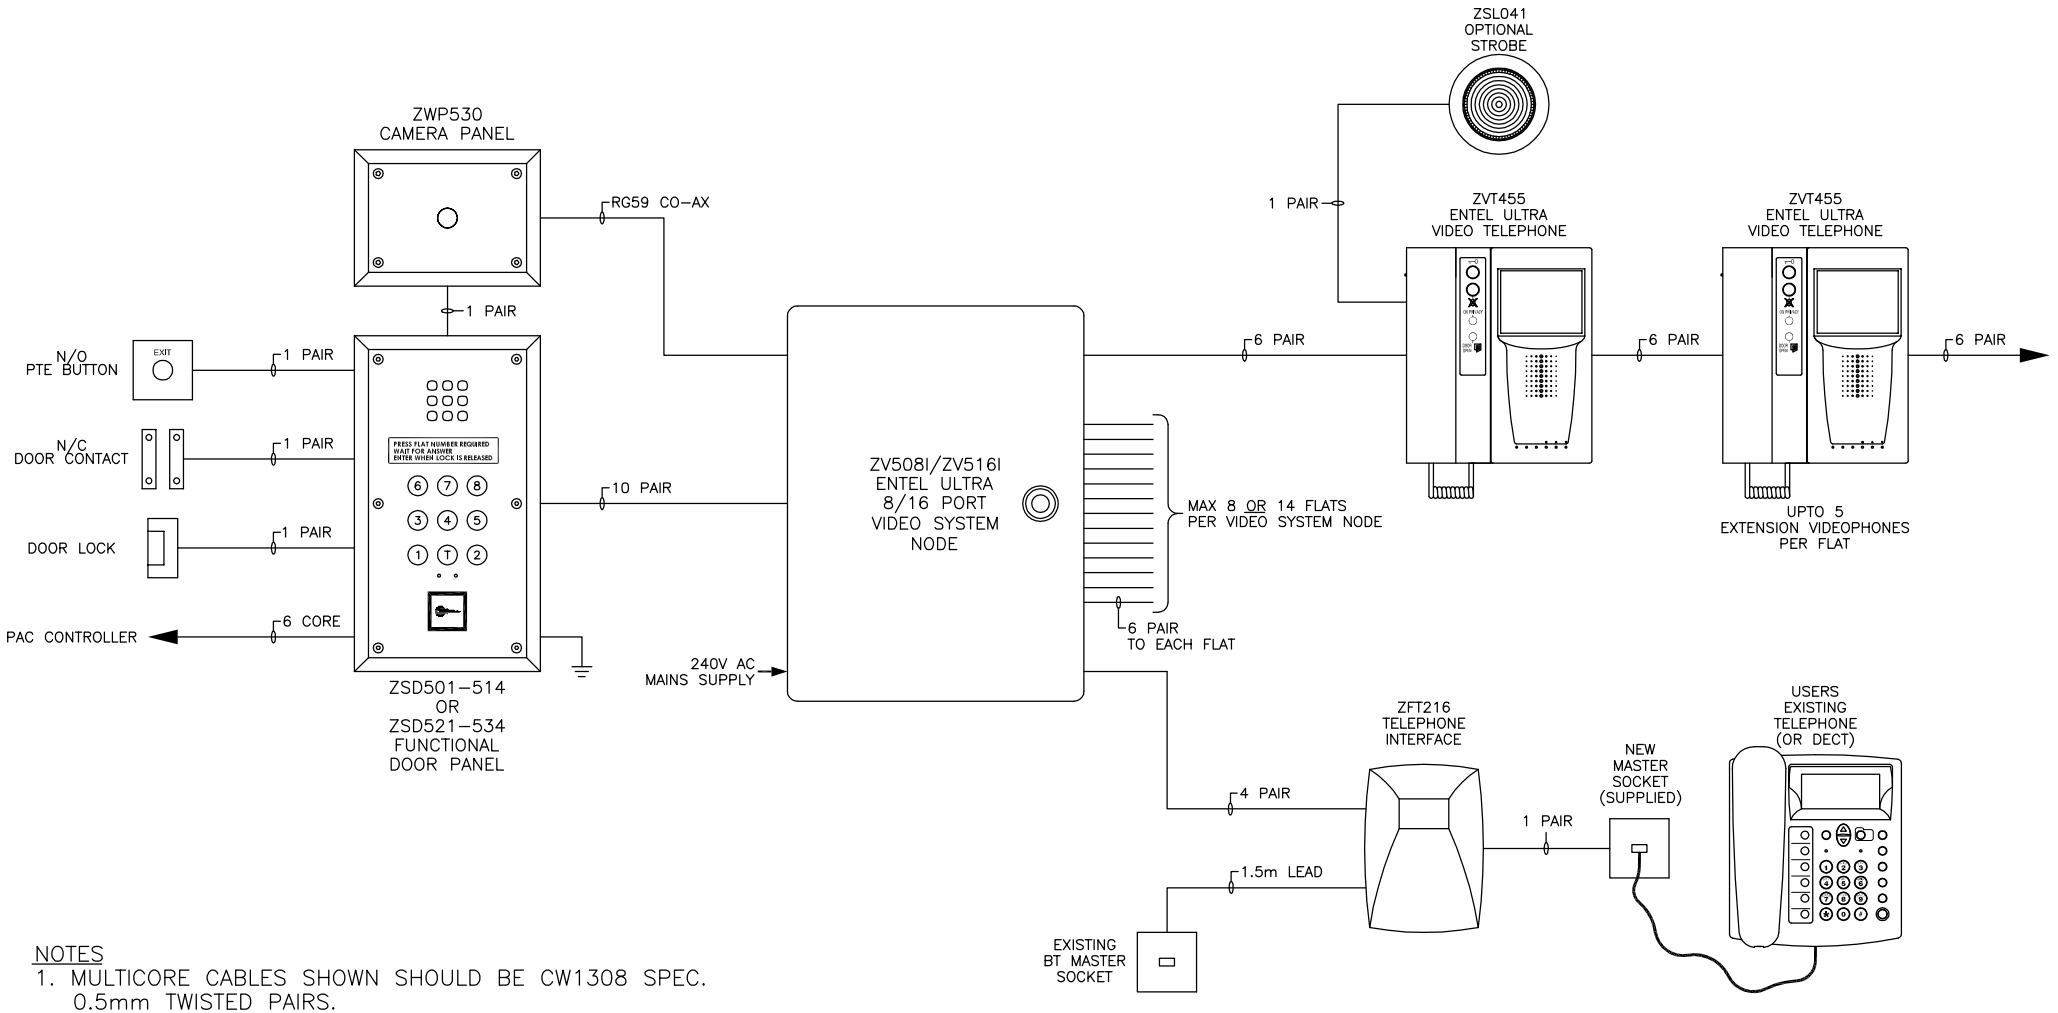


NOTES

1. MULTICORE CABLES SHOWN SHOULD BE CW1308 SPEC. 0.5mm TWISTED PAIRS.
2. RG59 SPEC. CO–AXIAL CABLE SHOULD BE USED FROM THE CAMERA TO THE SYSTEM NODE.
3. CO–AX IS NOT REQUIRED BETWEEN THE SYSTEM NODE AND VIDEO MONITORS.
4. THE DOOR PANEL MUST BE EARTHED.

CUSTOMER:				TOLERANCES	SHEET 1 OF 3
				ALL DIMENSIONS AND TOLERANCES IN mm UNLESS OTHERWISE STATED 0–100±0.4 | 600–OVER±1.2 100–600±0.8 | ANGULAR±1°	Tynetec is a business unit of Legrand Electric Ltd. Tel: (01670)352371 Fax: (01670)362807
08160001	B	VIDEO PHONE CHANGED	04/08/16	All parts supplied must conform to the requirements of the RoHS Directive (2011/65/EU) unless otherwise specified and agreed with Tynetec prior to shipment.	legrand®
MOD No	MOD	DESCRIPTION	DATE		
Drn. IJD	Chkd.	File WD0292A	Scale NTS	TITLE ENTEL ULTRA VIDEO DOOR ENTRY SINGLE ENTRANCE FUNCTIONAL BLOCK DIAGRAM	Drg No. WD0292

© and property of LEGRAND ELECTRIC LTD. – Communication with third parties is not allowed without permission.

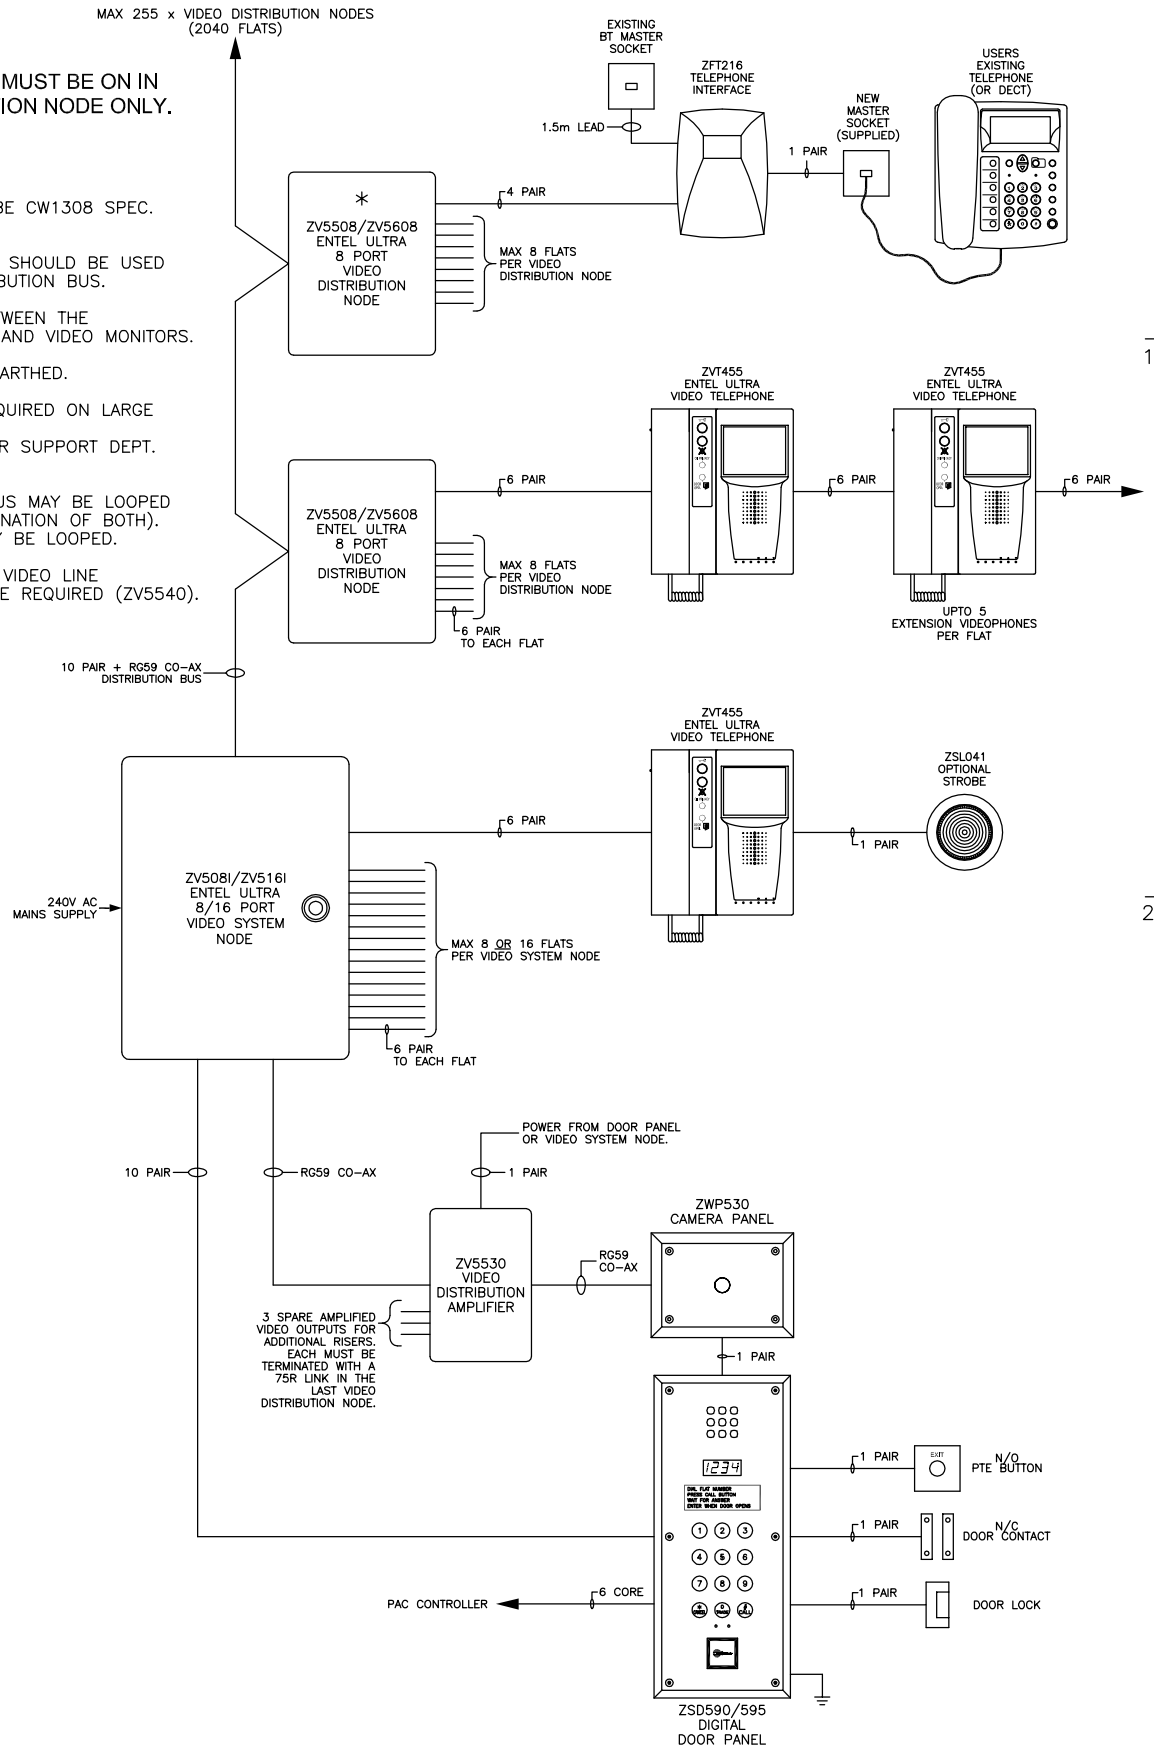

NOTES

1. MULTICORE CABLES SHOULD BE CW1308 SPEC. 0.5mm TWISTED PAIRS.
2. RG59 SPEC. CO-AXIAL CABLE SHOULD BE USED FOR THE CAMERA AND DISTRIBUTION BUS.
3. CO-AX IS NOT REQUIRED BETWEEN THE SYSTEM/DISTRIBUTION NODES AND VIDEO MONITORS.
4. THE DOOR PANEL MUST BE EARTHED.
5. ADDITIONAL PSUs MAY BE REQUIRED ON LARGE SYSTEMS. CONTACT TYNETEC'S CUSTOMER SUPPORT DEPT. FOR ADVICE.
6. THE 10 PAIR DISTRIBUTION BUS MAY BE LOOPED OR STAR WIRED (OR A COMBINATION OF BOTH). THE RG59 CO-AX MUST ONLY BE LOOPED.
7. FOR VERY LARGE SYSTEMS A VIDEO LINE CORRECTOR/EXTENDER MAY BE REQUIRED (ZV5540).

* IMPORTANT
THE "END OF LINE" SWITCH MUST BE ON IN THE LAST VIDEO DISTRIBUTION NODE ONLY.


CUSTOMER:				TOLERANCES	SHEET 2 OF 3
				ALL DIMENSIONS AND TOLERANCES IN mm UNLESS OTHERWISE STATED 0–100±0.4 600–OVER±1.2 100–600±0.8 ANGULAR±1°	Tynetec is a business unit of Legrand Electric Ltd. Tel: (01670)352371 Fax: (01670)362807
08160001	B	VIDEO PHONE CHANGED	04/08/16	All parts supplied must conform to the requirements of the RoHS Directive (2011/65/EU) unless otherwise specified and agreed with Tynetec prior to shipment.	legrand®
MOD No	MOD	DESCRIPTION	DATE		
Drn. IJD	Chkd. _	File WD0292B	Scale NTS	TITLE ENTEL ULTRA VIDEO DOOR ENTRY SINGLE ENTRANCE DIGITAL BLOCK DIAGRAM	Drg No. WD0292

©and property of LEGRAND ELECTRIC LTD. Communication with third parties is not allowed without permission.

Drg No. WD0292

DO NOT SCALE

THIRD ANGLE

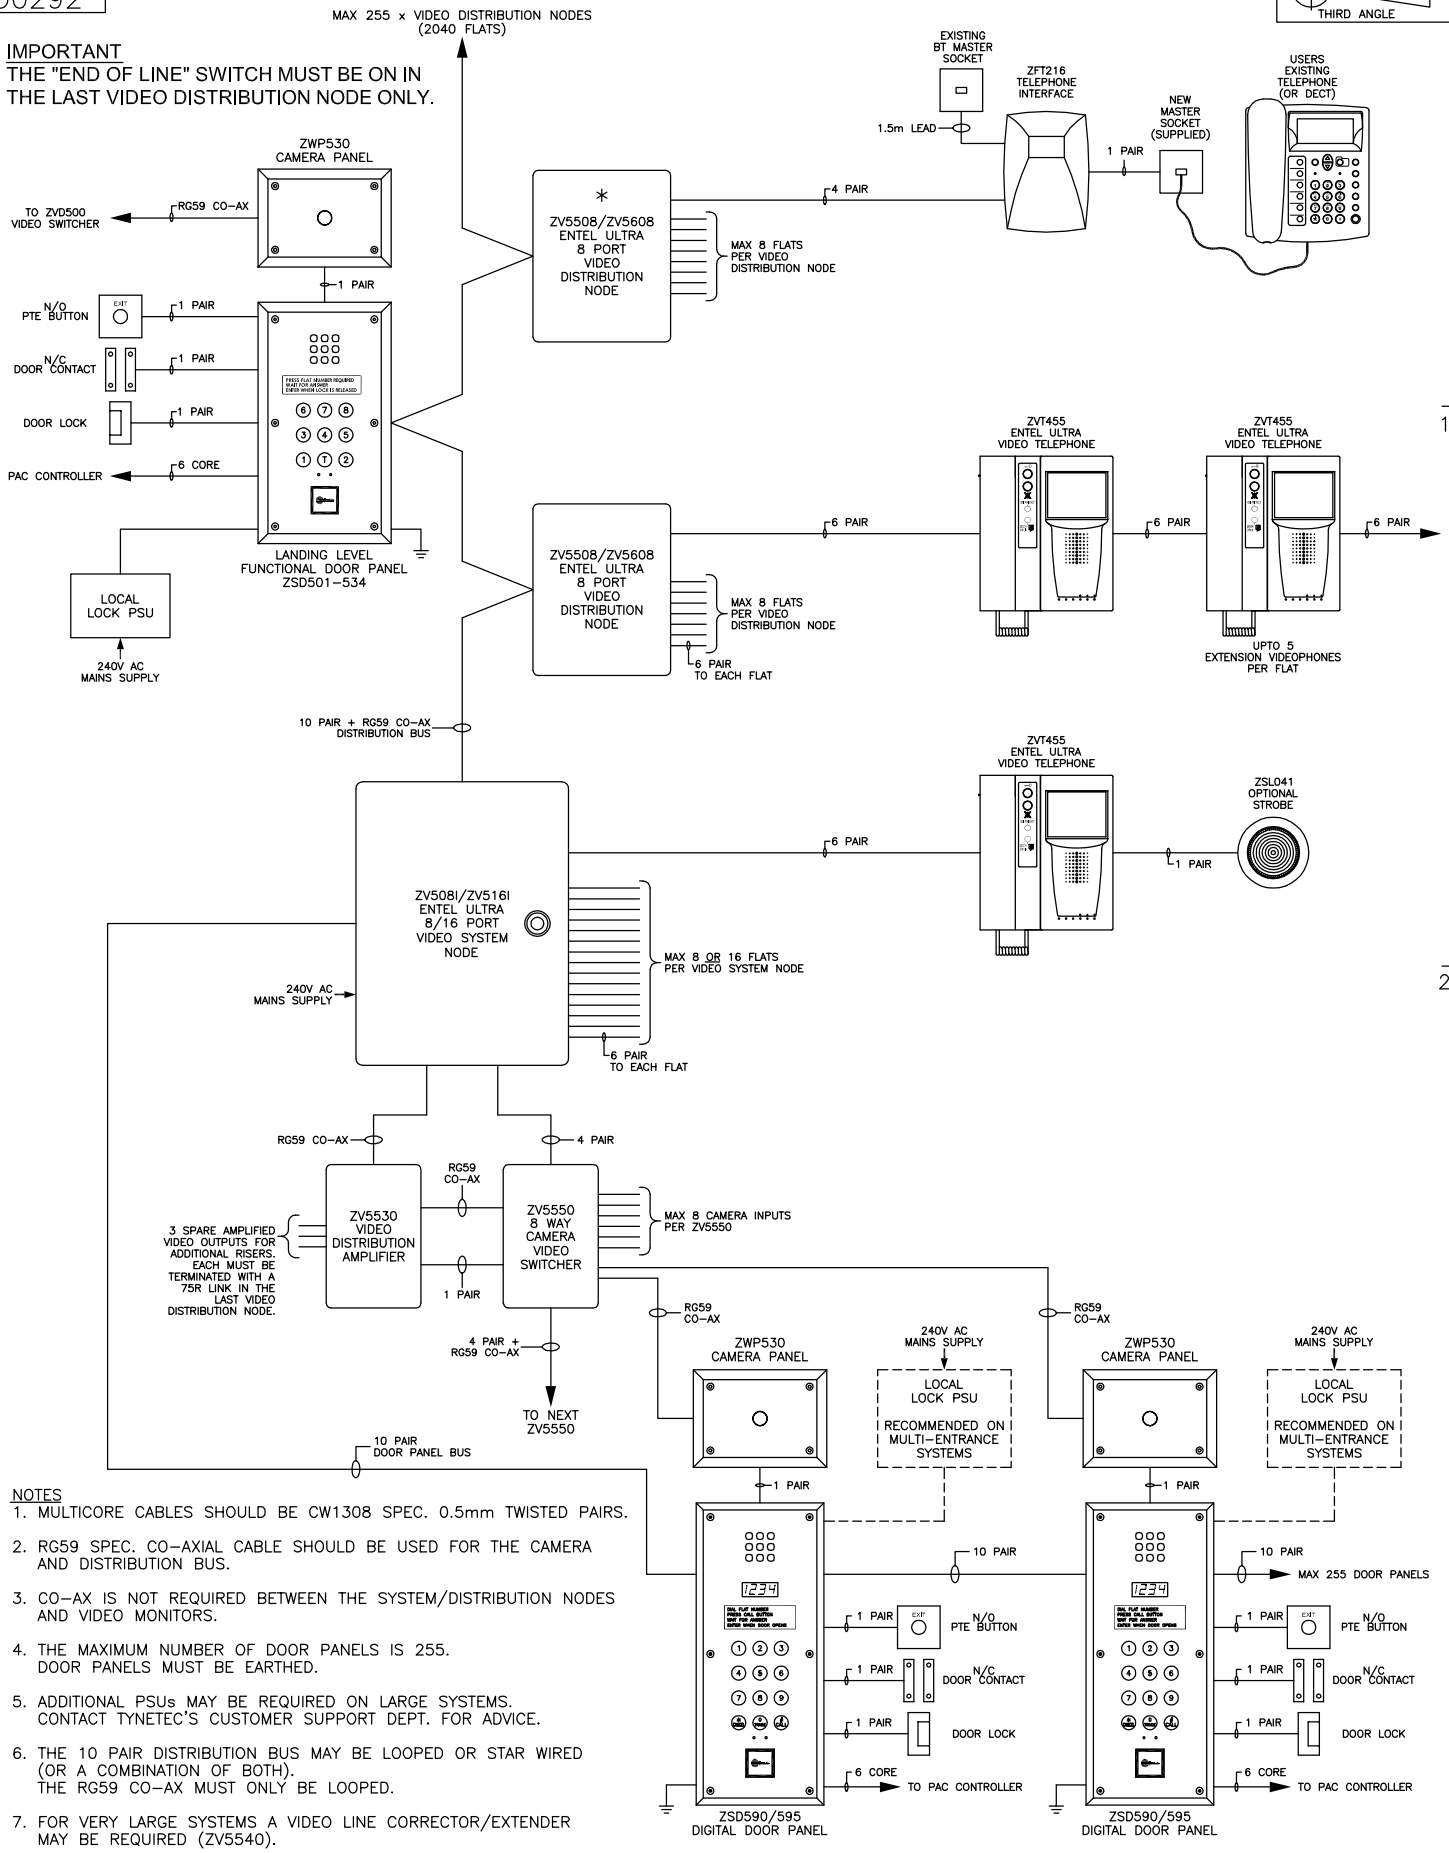

NOTES

1. MULTICORE CABLES SHOULD BE CW1308 SPEC. 0.5mm TWISTED PAIRS.
2. RG59 SPEC. CO-AXIAL CABLE SHOULD BE USED FOR THE CAMERA AND DISTRIBUTION BUS.
3. CO-AX IS NOT REQUIRED BETWEEN THE SYSTEM/DISTRIBUTION NODES AND VIDEO MONITORS.
4. THE MAXIMUM NUMBER OF DOOR PANELS IS 255. DOOR PANELS MUST BE EARTHED.
5. ADDITIONAL PSUs MAY BE REQUIRED ON LARGE SYSTEMS. CONTACT TYNETEC'S CUSTOMER SUPPORT DEPT. FOR ADVICE.
6. THE 10 PAIR DISTRIBUTION BUS MAY BE LOOPED OR STAR WIRED (OR A COMBINATION OF BOTH). THE RG59 CO-AX MUST ONLY BE LOOPED.
7. FOR VERY LARGE SYSTEMS A VIDEO LINE CORRECTOR/EXTENDER MAY BE REQUIRED (ZV5540).

CUSTOMER:				TOLERANCES	SHEET 3 OF 3
				ALL DIMENSIONS AND TOLERANCES IN mm UNLESS OTHERWISE STATED 0-100±0.4 | 600-OVER±1.2 100-600±0.8 | ANGULAR±1°	Tynetec is a business unit of Legrand Electric Ltd. Tel: (01670)352371 Fax: (01670)362807
08160001	B	VIDEO PHONE CHANGED	04/08/16	All parts supplied must conform to the requirements of the RoHS Directive (2011/65/EU) unless otherwise specified and agreed with Tynetec prior to shipment.	legrand®
MOD No	MOD	DESCRIPTION	DATE		
Drn. IJD	Chkd. _	File WD0292C	Scale NTS	TITLE ENTEL ULTRA VIDEO DOOR ENTRY MULTI-ENTRANCE DIGITAL BLOCK DIAGRAM	Drg No. WD0292

©and property of LEGRAND ELECTRIC LTD. Communication with third parties is not allowed without permission.